

Air-conditioning condenser integrated with a spray system utilizing condensate water

Jun-jun Wu, Bin Lin, Yu Tan, Hua Li, Cheng-cheng Huang, Lei Cao

Abstract:

Recycling the condensate water is environmentally friendly routine for energy saving in modern buildings. Aiming at the waste cold utilization of condensate water, a novel spray system employing the cold water as substance was proposed to cool the condenser. The condensate water forms thin liquid film which is crushed into tiny droplets later in the nozzle. Carried by the condensing air, the spray droplets are easy to deposit on the surface of condenser exchanger. And thus the evaporation can take place over the hot surface homogeneously. With this facility, the condensate water can be well recycled during the usage of air conditioning. In this way, it can prevent the condensate water from environment pollution. And this facility is helpful for energy saving and CO₂ emission, as well as good economic return.

Key Words:

Condensate water, spray, heat exchange, energy saving

Introduction

As increasing constantly of the energy need globally and rapid consumption of non-renewable energy, the energy supply is becoming tense. From the view of resource consumption, 1/6 of resource consumption in the world relating directly to construction industry, the construction energy consumption totally accounts for 27.6% of total energy consumption. In the construction energy consumption, the energy consumption used in Heating Ventilation and Air Conditioning (HVAC) accounts for 30%-50% [1]. Air conditioner operated in summer, when the surface temperature of an evaporator is lower than the dew-point temperature of the ambient air, vapors in the air will be condensed to form water film on the surface of the evaporator. And the condensate water results from the constant heat and mass transfer of the air around the film and the water film. It is a kind of waste for energy to discharge disorderly the condensate water. With the concept of the energy saving and emission reduction, the condensate water draws more and more attentions.

There are two ways using the condensate water: one is to use it as water resource: (1) for the central air-conditioner, a lot of the condensate water after processing can be used as the supply for units of the cooling tower [2-3]. Another is to use it as sanitary water in public places, such as the airport lounges and the railway station waiting area. But in recent years, the development of split type air conditioner

in China is rapid. The condensate water produced by this air conditioner has large refrigerating capacity. The condensate water needn't discharge into the air, and it can be used to pre-cool the air which is into the condenser. It's good for the heat rejection of condenser and lower the energy consumption in the operation.

Some researches [4-6] have been conducted for the energy saving and utilization of the air condensate water, and some obtained achievements [7-8]. The solution that the condenser is cooled to lower the temperature of outdoor unit by the condensate water is a mature technology of the utilization of the condensate water. Simple equipment, effective energy saving and good economic benefits are advantages of this technology. There are three major methods cooling the condenser by condensate water, including spraying method, wet membrane method and the method of adding a condenser. The spraying method is to collect condensate water into a collection plate. By using a control system of water level, when the water level is up to the preset height, the condensate water is elevated and sprayed with the condenser. Water evaporation absorbs a lot of heat, increasing heat rejection. The refrigeration effect of the system enhanced obviously, saving the energy, especial the electric energy. The disadvantage that the volume of condensate water is small will lead the discontinuous and unsteady operation of the air conditioner system. Wet membrane method is to put up the breathable non-woven fabric on the two side of the condenser, adding the area of heat transfer. When condensate water is sprayed with the condenser, it will cool the whole surface of condenser in the evaporation process, increase the heat rejection and enhance the refrigeration effect, achieving the goal of saving energy. The method only needs simple equipment, but has a great effect of saving energy. Adding the additional condenser is to add an evaporative condenser in series before the air cooled condenser of initial air conditioner system. The temperature is reduced by the evaporating of the condenser water sprayed with condenser. Another method is adding an assistant condenser, i.e. setting another condenser as assistant for the origin air-cooling condenser in the air conditioning system. Via the evaporation of spray condensate water, the temperature of the condenser is decreased. Compared with the spray and wet film, all the cooper pipe and fins in the condenser are made of anticorrosion materials thus can avoid the erosion on aluminum fins caused by condensate water.

Chen Nan et al. [13] made a comparison about the capacity of condensate water among different climate, and it was found that the capacity of condensate water is larger in South and East of China, resulting in a better energy-saving efficiency. Zhao Tao et al. [14] proposed three prototypes for condensate water usage: 1) make the condenser exchanger sink in the cold water and thus to improve the heat exchanging efficiency; 2) Use a fan to deposit the water on the hot surface and the unevaporated water is collected for reuse; 3) Employ a pump to spray the water on the condenser. It was proved that prototype 3 was the most efficient way for better heat exchange. The COP is improved and the cooling capacity is increased as well. Chen En, Yu Jing et al. [15-19] carried out a calculation of capacity of water for split-type air conditioner. And the variation of COP is analyzed due to using the cold water to cool condenser. Besides, it was practically applied technology to use the condensate water to cool the condenser in Germany in 1996. And some relative patents has also been published in the US. Charles L. Michael [20] invented a facility to clean the condensate water for drinking. Kevin Teller [21] introduced several patents concerning recycling condensate water for cooling condenser during 1992 to 1997. The working principles were briefly introduced and a novel invention for using the waste cold of condensate water was also proposed.

In all, it is a concerning topic to combine the air conditioning system with building energy saving. As for the present work, a prototype to cool the condenser with spray under ultralow cold water

flowrate is proposed. And the results indicated that the usage of this facility gave rise to lower energy consumption and CO₂ emission.

2. System design

2.1 The calculation of condensate water

2.1.1 The Assumptions for calculation

A split-type air conditioner was taken as an example which brand is KFR72W/E1(72553L1)C1-N3 in the room 215 of Power building, Chongqing University. We calculated the production of condensate water that the air conditioner generated in operating condition in summer.

To simplify the calculation, some assumptions was made as below:

- (1) The influence of building structure and placement on cooling load is negligible;
- (2) The air conditioner runs steady in operating condition;

2.1.2 The parameters

(1) The parameters of air conditioner

The main parameters of air conditioner are as shown in Table 1:

Table 1 Operating parameter of the selected air conditioner

Cooling capacity □W□	heating capacity□W□	Circulating flow (m ³ /h)	rated power□W□
7200	8200	1150	2410/2530

(2) Outdoor air parameters

According to The design manual of heating air conditioning and we take outdoor meteorological condition in Chongqing into account. Outdoor air parameters are as shown in Table 2.

Table 2 Outdoor air properties

atmospheric pressure□hPa□	dry-bulb temperature □□□	wet bulb temperature □□□	average daily temperature□□□	Outdoor air speed□m/s□
991.2	36.5	27.3	33	2.4

(3) Indoor air properties

According to the design manual of air conditioner, indoor air properties are as listed in Table 3:

Table 3 Indoor design parameters

temperature□□□	relative humidity□%□	air speed□m/s□
24-28	40-65	≤0.3

According to the Tables, set indoor air parameters : $t_N = 24$ □□ $\psi_N = 60\%$ □

(4) Fresh air ratio

Due to the frequent going in and out of the office, opening or closing windows and doors, accordingly, the fresh air ratio was set at 10%

2.2.3 The calculation of condensate water

1. Cooling load

According to the air conditioning type, the refrigerating capacity is rated as 7200 W, in the process of actual operation, in order to simplify the calculation, regard the indoor cooling load as the rated refrigerating capacity calculation directly, $Q = 7200$ W.

2. Humidity load

Humidity load is derived from the moisture gain of the room, And the moisture gain of the room is depend on its using properties. The moisture gain of the lab consist of moisture gain from occupant, food, fresh air and opening water surface etc.

(1) Moisture gain from occupant

There are 9 man and 3 women in the lab, moisture gain from a woman is 84% of a man, so moisture gain from occupant:

$$m_1 = \frac{1}{1000} n \psi g = 1.847 \text{ kg / h} \quad (1)$$

n — The number of people indoor;

ψ — Clustering coefficient, 0.96;

g — Moisture gain from a man per hour, taken as: 167 g/h;

(2) Moisture gain from food

According to the literature, moisture gain from food is about 10 g/h per person, consequently, the moisture gain from food is m_2 :

$$m_2 = 0.12 \text{ kg / h} \quad (2)$$

(3) Moisture gain from fresh air

The fresh air penetrate in the lab through the windows and the doors, the fresh air is 10% percent of the circular air rate, actually, fresh air volume is $115 \text{ m}^3/\text{h}$, consequently, the moisture gain from fresh air is m_3 :

$$m_3 = \rho G' (d_w - d_c) = 0.969 \text{ kg / h} \quad (3)$$

(4) Moisture gain from opening water surface

The moisture gain from opening water surface is calculated as followed:

$$m_4 = Fg' = 0.0013kg / h \quad (4)$$

Where:

F —— the evaporation surface area of the water channel, unit: m^2 ;

g' —— evaporation capacity per square meter, unit: $kg/m^2 \cdot h$.

Humidity load in the lab□

$$m = \sum_{i=1}^4 m_i = 2.973kg / h \quad (5)$$

3. The calculation of condensate water

According to temperature and humidity parameter of air indoor and outdoor, confirming the state points N, W indoor and outdoor. Confirming the mixed state point C according to the fresh air ratio. The air at mixed state point C was cooling and dehumidification through the air cooled heat exchanger, and intersects the relative humidity line $\psi=90\%-95\%$ at L, L point is the point of ventilation state, the cooled air is supplied into the room, subsequently cooling and dehumidifying the air indoor, and then reached at state point N along the heat moisture ratio line ε , latterly mixed with fresh air at state point C. The air treating processes indoor circulate like this, and the psychrometric chart of this process is showed as figure 2-1.

Outdoor state point W: it is determined by the dry-bulb temperature $t_w=36.5^\circ$, wet bulb temperature $t_{sw}=27.3^\circ$, checking the psychrometric chart(Fig 2-2) and confirming the enthalpy value h_w and moisture content d_w , respectively $h_w=88.09$ kJ/kg, $d_w=19.94$ g/kg.

Indoor state point N: according to the given indoor temperature $t_N=24^\circ$, relative humidity $\psi_N=60\%$, checking the psychrometric chart(Fig 2-2) and confirming the enthalpy value h_N and moisture content d_N , respectively $h_N=53.71$ kJ/kg, $d_N=11.58$ g/kg.

Mixed state point C: according to the mixed theory of two different state of air, mixed state point locate on line NW, and fresh air ratio k satisfy:

$$k = \frac{h_C - h_N}{h_W - h_N} \quad (6)$$

$$k = \frac{d_C - d_N}{d_W - d_N} \quad (7)$$

Take the date into the terms above to confirm the enthalpy value h_C and moisture content d_C , respectively $h_C=57.148$ kJ/kg, $d_C=12.416$ g/kg.

The mixed air from indoor and outdoor is bring in air-condition, and then is treated latterly supplied into the lab, along the heat moisture ratio line ε reached at indoor state point N, moisture ratio ε :

$$\varepsilon = \frac{Q}{m} = \frac{7.2 \times 3600}{2.973} = 8825.3kJ / kg \quad (8)$$

In the psychrometric chart, across indoor state point N draw moisture ratio ε intersects the relative humidity line $\psi=95\%$ at L, confirming point L: moisture content $d_L=9.99$ g/kg□density $\rho=1.183$ m^3/kg .

According to moisture content balance: the quantity of condensate water from air-condition is M:

$$M = \rho G(d_c - d_L) = 3.042 \text{ kg/h} \quad (9)$$

Finally: the quantity of condensate water from air-condition in summer is: 3.042 kg/h.

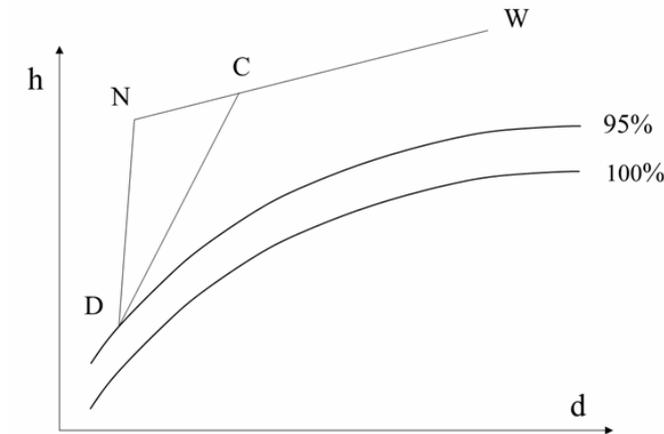


Figure 1 the psychrometric chart in the air treating process

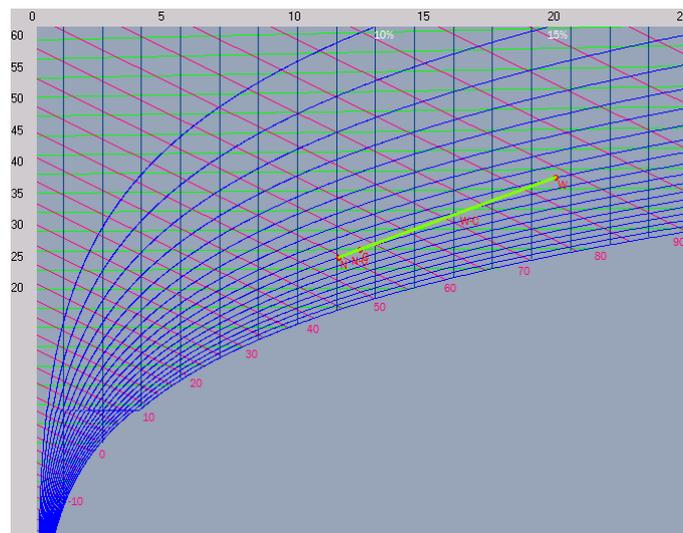


Figure 2 the psychrometric chart

2.2 Design of spray system

To guarantee the spray droplets to deposit on the condenser uniformly, twelve nozzles are arranged in this system. Thus the flowrate in each nozzle can be derived as following:

$$q = \frac{M}{N} = \frac{3}{12} = 0.25 \frac{\text{L}}{\text{h}}$$

(10)

where q is the flowrate in each nozzle, M is the total water flowrate, and N is the nozzle number.

For the flowrate in each nozzle is quite low, a peristaltic pump (FB-RDB6) is employed to spray periodically under a range of 1.25 mL/min-650 mL/min, cf. Figure 3.



Figure 3 the diagram of peristaltic pump



Figure 4 the diagram of mini-type fan

It's difficult to spray the cold water in single liquid phase due to ultralow flowrate and low pressure of peristaltic pump. Thus air assistant spray was taken into consideration. A mini-type fan was set to blast air into the nozzle and thus crush the liquid film into fragments. A fan (WS7040-24-8) was selected, which provide a wind pressure as high as 6 kpa. Considering the pipe resistance, the final pressure was reduced to 3-4 kpa. Additionally, by slotting the cold water pipe inserted in the nozzle, a liquid film with 0.05 mm in thickness was obtained. Thereafter, air blasting happened to the thin film for better spray atomization. According to the force balance on the liquid film, the film would break up into pieces as external force overcomes the viscous force and surface tension, which is described as:

$$\frac{\sigma}{\delta} < p_{air} \quad (11)$$

Where σ is surface tension, δ is the liquid film thickness, and p_{air} is air pressure provided by fan. Then substitute the data into the equation as below:

$$\frac{\sigma}{\delta} = \frac{0.0731}{0.00005} = 1462 \text{ pa} < 3000 \text{ pa} \quad (12)$$

A conclusion can be arrived that the spray is technically practical. Moreover, the spray atomization is implemented due to the variation of surface tension and aerodynamics. The spray mode can be classified as the first wind-induced spray. According to the theory, the droplets size is in the same magnitude of liquid jetting. Thus the droplet size is predicted as 0.05 mm as well.

2.3 The prototype of system

As shown in Figure 5, a micro spray system based on condensate water, which contain water system and air system. Water storage tank, peristaltic pump and water pipe, all of them made up the water

system. Water storage tank, cover with insulation layer that used for preventing condensate water exchange heat with the environment, is used to collect condensed water. Condensate via the water piping to spray nozzle by the driving of the pump; Air system include draught fan and air piping. The air outside is pump to the nozzle by the fan before mixed with condensate water, then mixture of air and condensed water would transfer heat with refrigerant of High temperature and high pressure through the fin.

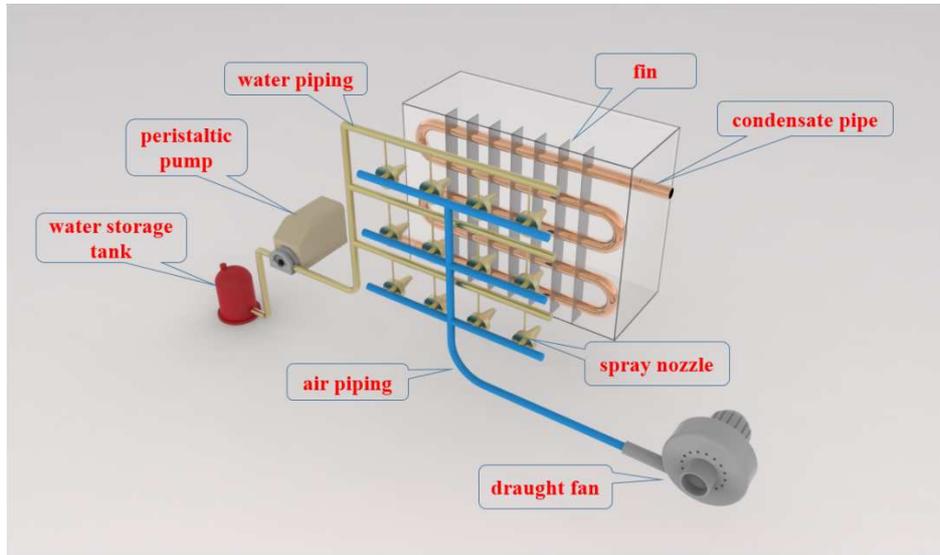


Figure 5 the overall system diagram

Key component of the system is spray nozzle, just as shown in Figure 6. Condensate water is pumped into nozzle via the water piping, at the end of which is designed to be flat with fistulous internal structure, making condensate water well atomized and distributed in the mixing chamber. When air through the air piping to the chamber and crash the spray of condensate water into smaller droplets. It would improve the heat transfer coefficient and increase the refrigeration capacity under combined effect of the improving of air flow rate and the evaporation of the recycling condensate water, so as to achieve the effect of energy conservation and emissions reduction.

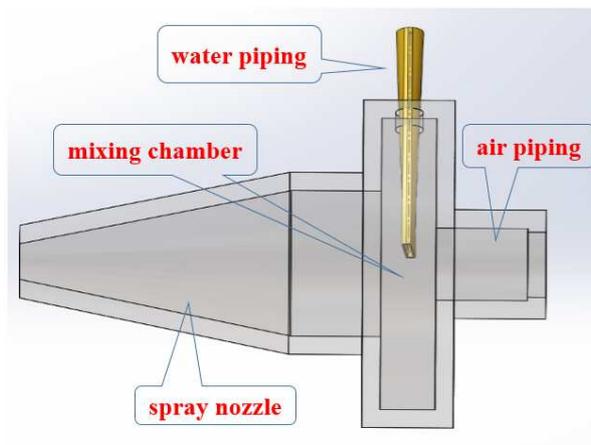


Figure 6 schematic diagram of spray nozzle

3. Efficiency calculation

The efficiency calculation of the system has been carried out, which is related to economy and reliance. For instance, the refrigerating capacity was set as 7200 W, power rating was set as 2410 W.

The operating condition were as following: outdoor environment temperature was 36.5 °C, the indoor temperature was controlled at 26 °C, condensation temperature was 50 °C, evaporation temperature was 5 °C, subcooling temperature drop was 5 °C, superheating temperature increase is 2 °C. The pressure drop and flash evaporation is neglected during the refrigerant flow process and the refrigerant working medium was assumed to be R22.

The refrigeration cycle of P-h was shown in Fig. 8. The calculated COP was as follows:

(13)

The flow rate of R22 was:

$$q_m = \frac{7200}{408.62 - 256.31} = 47.27 \frac{g}{s} \quad (14)$$

As shown in Figure 7. When spray wasn't adopted, all the heat of condenser was used to heat air, on the enthalpy wet graph was a straight up line point 1 to point 2. It can be figured out:

$$Q = G(h_2 - h_1) \quad (15)$$

When spray was adopted, condenser heat dissipating capacity was divided into two parts: the evaporation latent heat of the condensate water Q_{water} , the heat used to heat the air Q_{air} . The air in the condenser can be considered as a constant moisture content heating process, as shown in Figure 8, point 1 to point 3, then the heated air absorbed the vaped condensate water at a constant temperature, the state of the mixed turned into point 4. The process on the psychrometric chart was point 3 to point 4. It can be figured out:

(16)

$$Q_{water} = M_{water} \cdot h_{latent} \quad (17)$$

$$Q_{air} = G(h_3 - h_1) = kA\Delta t \quad (18)$$

$$Q_{water} = G(h_4 - h_3) \quad (19)$$

In the aforementioned formulas, Q was total heat exchange amount; Q_{water} was heat exchange amount of condensate water; Q_{air} was heat exchange amount of air; M was mass flow rate of condensate water; K was coefficient of heat transfer; A was heat transfer area of condenser. It can be concluded that the increase of Q_{water} give rise to the decrease of Q_{air} , when the heat exchange amount was constant. The heat exchange area and the coefficient of heat transfer remain unchanged, hence Δt decreased, result in the decreasing of condensing temperature. The calculating result showed that the condensing temperature decreased about 2.85 °C.

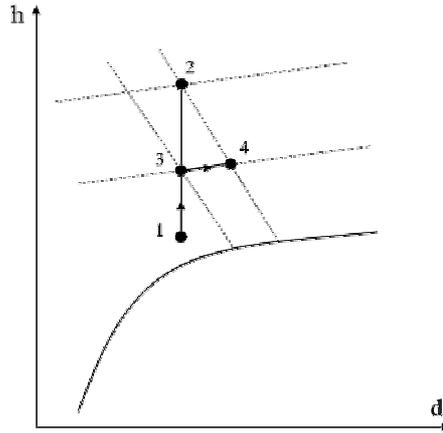


Figure 7 Enthalpy wet figure of the heating processes of the cooling air

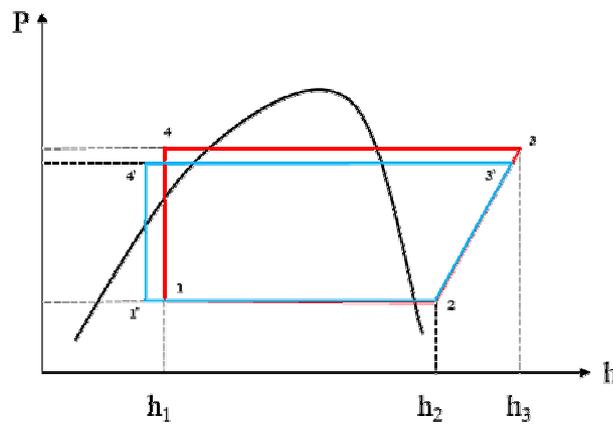


Figure 8 Refrigeration cycle comparison before and after adding spray

As shown in Figure 8. The refrigerating cycle were 1-2-3-4 before spray system was added. The condensing temperature decreased after spray system was added, and the refrigerating cycle turned into 1'-2'-3'-4'. Checked the pressure-enthalpy chart of R22, it can be calculated as follows:

$$COP_1 = \frac{408.62 - 256.31}{439.08 - 408.62} = 5.00 \quad (20)$$

$$COP_2 = \frac{408.62 - 252.85}{437.69 - 408.62} = 5.36 \quad (21)$$

The main calculation results were shown in Table 4:

Table 4 Systemic changes before and after adding spray

	Refrigerating capacity (kJ/kg)	Compression work □W□	COP
No spray	7200	1439.84	5.00
Spray	7363	1374.14	5.36
Varies	↑2.2%	↓4.5%	↑7.2%

For example, the rated power of the air conditioner was 3 kW. It is supposed to work for 10 hours a day, 120 days a summer and thus, the electricity consumption was worth RMB 3600. Adopting the proposed method, subtracted the electricity consumption of pump and fan which was approximately equal to 60 W, 181 yuan electricity charges can be saved each year. The cost was RMB 340 each unit,

the cost can be recovered in 1.87 year. In 2014 china building have energy consumption was 1.25×10^{17} kJ, If all the household air conditioner adopted the proposed air-conditioning condenser integrated with a spray system utilizing condensate water in this work, the benefits were as follows:

1. Energy-saving benefit: if the air conditioner energy consumption took up half of the total energy consumption, 1.16×10^{12} kW·h energy can be saved, equivalent to about 1.42×10^8 t of standard coal.

2. Emissions Benefits: The saving electricity is generated by coal, if the power generation efficiency is 36%, about 3.96×10^8 t standard coal can be saved, about 1.07×10^9 t emissions were reduced.

3. Economic benefit: If electric charge was 0.5 yuan per kilowatt-hour, throughout the year China can save about RMB 58 billion.

4. Conclusion

1. When refrigerating capacity maintains 7200 W and relative humidity of outdoor in air keeps at 48.9%, the condensate water generated at the rate of 3 kg/h;

2. By forming a liquid thin film uniformly and then being crushed into fragments, spray droplets within 0.05 mm in diameter can be obtained successfully.

3. By adopting the spray system, the temperature of condenser is reduced. t is decreased as well. With refrigerating capacity increasing and the energy consumption of compressor decreasing, the COP of the system is improved significantly.

Reference

[1] Chen Peng, Lu Jun, Zhang Huimin, Huo Zhenzhen, Zeng Xiao, Experiment research of recycle the condensate water of spilt air-conditioner[J]. Journal of Civil, Architectural & Environmental Engineering, 2012, S2:169-172.

[2] Deng Yanqing. Discussion about condensate water recycling technologies[J]. Science & technology vision. 2014 (20): 270-270.

[3] Zhang Yu, A brief comment on the appliance of condensate water recycling technologies[J] Intelligence, 2012.1.

[4] Chen En, Shi Min, Guo Jian, Xu Jiabin. Analysis of energy-saving efficiency by recycling condensate water for cooling condenser[J]. Refrigeration & air conditioner, 2004,05:75-77.

[5] Wu Dongxing, Jin Sumin, Xu Jiabin. Analysis of energy conservation and utilization of air-conditioning condensate water[J]. Fluid Machinery. 2004,11:66-68.

[6] Zhao Qihua, Opinion on utilization of condensing water from room air conditioner and energy saving [J]. HV & AC, 2005,05:58-59.

[7] Liang Renjian, Analysis and application of air conditioning condensed water reusing technologies[J]. Journal of Guangdong Industry Technological College. 2009, 8(2):13-16.

[8] Zhen Zhaohui. Recycling the condensate water[J]. Science and Technology Innovation Herald. 2010,(15).

[9] Zhang Jiahui, Wang Peihong, Ma Yitai et al. Energy saving analysis of the device of recycling the condensate water in air conditioner[C]. The national hvac refrigeration academic conference, 1998.

- [10] Wang Liming. Appliaence of condensate water recycling technologies in design of air conditioner [J]. Refrigeration & Air conditioner. 2008, 8(B06): 146-147.
- [11] Li Sha, Zhou Pengfei. Using condensate water of spilt air conditioning to raise energy efficiency ratio[J]. Journal of Tianjin Polytechnic University, 2006,25(6):68-74.
- [12] Shen Bingjie, Zeng Zhixin, Li Yong et al. Experimental study on the utilization of condensed water[J]. Energy conservation technology. 2006, 24(2): 103-106.
- [13] Chen Nan, Sheng Jiang, Zhou Tonghua et al. Utilizing condensate water for energy conservation in room[J]. Air conditioner, 2003,33(3):117-118.
- [14] Zhao Tao, Xiaohonghai, Tan Chengbin, et al. Experimental Research on the Utilization and Energy Saving of Condensing Water from Minitype Split Air Conditioner[J]. Refrigeration & Air conditioner,2006(2).
- [15] Chen En, Shi Min, Guo Jian et al. The effect of recycling condensate water on the condenser cooling efficiency[J]. Refrigeration & Air conditioner. 2004,4(4):75-76.
- [16] Yu Jinghua. Study on the energy conservation of air conditioner in residential building of hot summer and cold winter zone[D]. Hunan University, 2007.
- [17] Ding Xingfeng, Zhou Jiyu. Study on the recycling condensate water in air conditioner [J].Energy Conservation, 2003,(2):10-15.
- [18] Xu Bo, Chen Jiangping. Experimental and theoretical analysis of energy saving by utilizing condensate water[C]. Academic Conference of Chinese Association of Refrigeration, 2009.
- [19]Charles L. Michael. Apparatus For Producing Filtered Drinking Water [P]. United State Patent: US005517829A, May. 21, 1996.
- [20]Ness R. Lakadawala. Water condensate recovery device [P].United State Patent: US004280334, Jul. 28, 1981.
- [21]Brasquet C. Adsorption of microparticulate onto fibrous activated carbon: assoction ofultrafition and fibre[J]. Wat SciTech, 1996, 34(9):215-222.